

WARNING

READ INSTRUCTIONS CAREFULLY BEFORE INSTALLING. KEEP THIS INSTRUCTIONS FOR FUTURE REFERENCE

Fixtures must be wired in accordance with the National electrical code and all applicable local codes. Proper grounding is required for safety.

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A QUALIFIED ELECTRICIAN WHO IS FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

WARNING: Risk of fire or electric shock. High bay Light installation requires knowledge of l uminares and electrical systems. If not qualified, DO NOT try to install.

Please contact an electrician.

WARNING: Risk of fire or electric shock. Suitable for wet locations. Make sure the power is off permier to install.

WARNING: Risk of fire or electric shock. Suitable for non-insulated surface and frame. DO NOT cover fixture with insulation liner or similar material.


WARNING: DO NOT install in unstable, loose or breakable surfaces.

WARNING: DO NOT let objects impact or exert force on the surface of the fixture.

SHOCK HAZARD!



Turn power OFF at circuit breaker prior to installation or servicing.

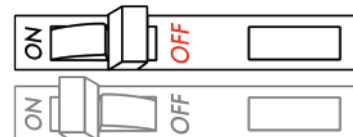


TOOLS REQUIRED

Tools:

1. Sharp Side Cutter
2. Electric Drill
3. Level
4. Measuring Tool
5. Wire Stripper / Knife
6. Philips Screwdrivers
7. Wire Cutters

WIRING


CORD/ SUOOLY WIRING

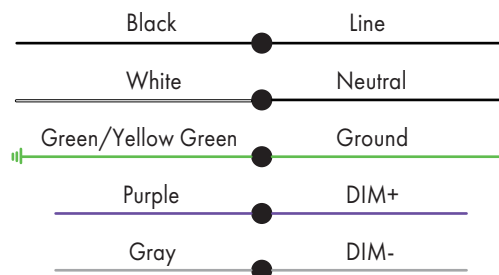

For Class I Div. 1 Group C,D location


1. Take the fixture and accessory out from cartoon box, tighten 2x angle holder screws.

1. Angle holder screw

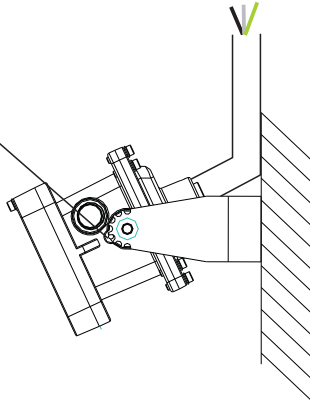


2. Through the cable to the explosion pipe and tighten the fixture with explosion pipe.

2. Explosion Conduit

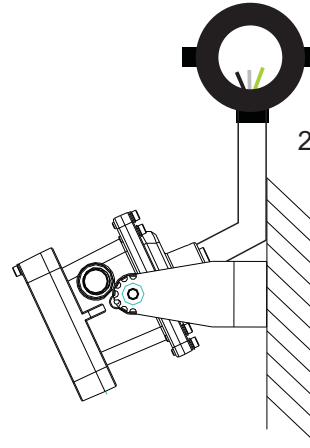

3. Drill 2x 10mm hole as the distance 171mm, fixing Ø18 expanded screws and bracket on ceiling. (Please keep the lamp installation height as least 1.2 meter)

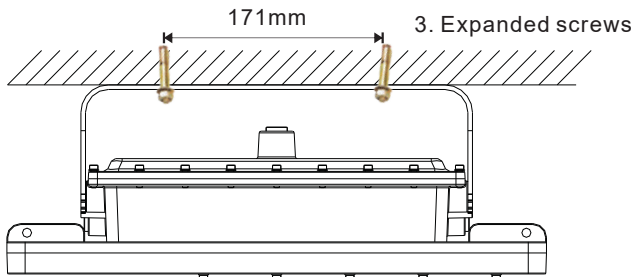

4. Connect the AC cable, Black cable joins to Live wire, white cable joins to Null wire, green cable joins to grounding. (Please use a hazardous location joint box)

4. Junction Box

